




# 326 RADIO RECEIVER

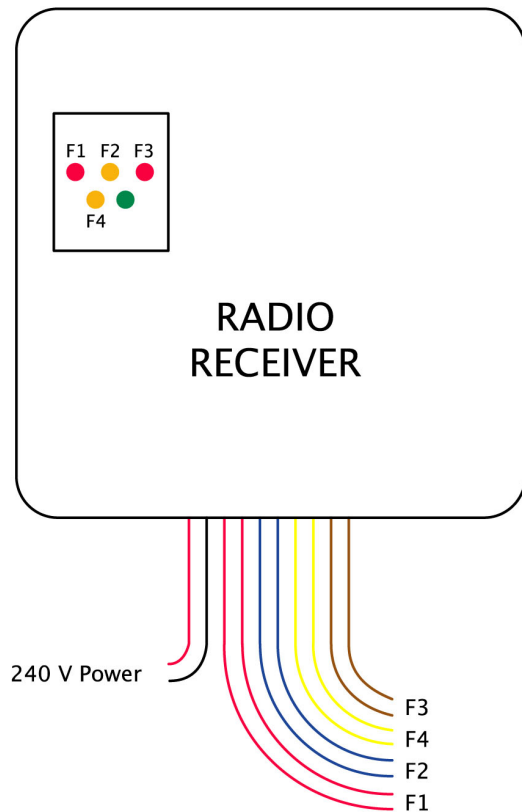

## Lights

F1 Water heating

F2 Electric heat and, or A/C

F3 A/C (if used)

F4 Stored heat (if used)

Green light – Test light

30A Orange wires – F1 N.C. Contact

5A Blue wires – F2 N.C. Contact

Brown wires – F3 Stearns use

Yellow wires – F4 Stearns use

Red  
Black } 240 V.A.C. POWER

## INSTRUCTIONS:

- Stearns Electric Association will not be responsible or liable for any personal injury or property damage in the wiring of or the operation of this or any Energy Wise system. Stearns Electric Association recommends the use of a licensed electrical contractor.
- All wiring must meet N.E.C. (National Electrical Code) and be inspected by a state electrical inspector before Stearns Electric Association will check out installation.
- Any time power is off & restored to the radio receiver, there will be a 15-minute time delay before unit will be allowed to operate.
- Radio receiver/meter socket should be mounted 4' to 6' above the ground outside of all structures with ample access around unit.